


Page 1 of 2

14.0 kVA Single Phase UPS System

Operates incandescent, magnetic and electronic ballast fluorescent, high power factor compact fluorescent, and high intensity discharge (HID) lamp types.

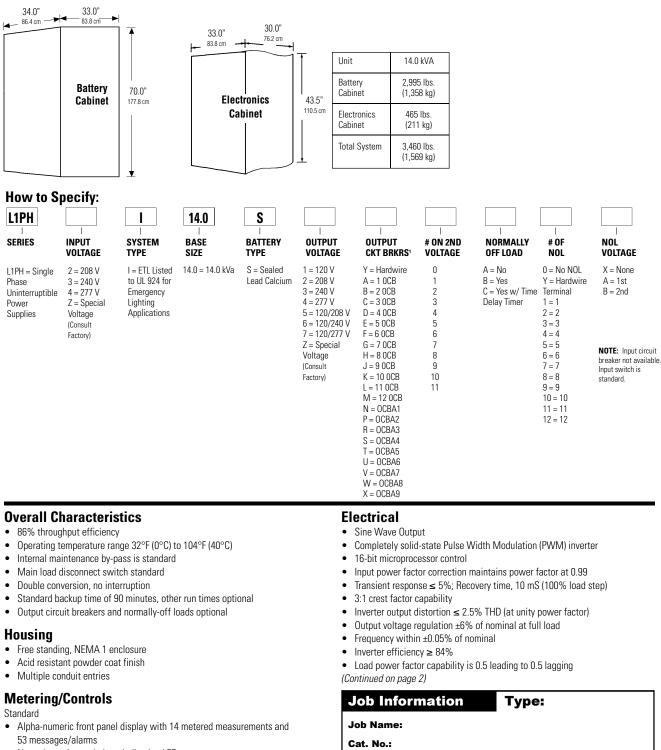

- Normal, caution and alarm indicating LEDs
- Audible failure alarms with silence switch
- Dry contact for remote failure alarm
- "D" type 9-pin computer interface connector (see pin config. on back)
- Programmable battery monitor with alarm
- Optional
- Diagnostics software for remote computer (PC) monitoring and control
- Stand-alone remote display mimics all measurements, indications and alarms shown on the front panel display
- Additional RS-232 input/output port for remote monitoring and system control

Lamp(s):

Notes:

LIGHTOLIER

Lightolier a Genlyte Thomas Company www.lightolier.com 631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710 We reserve the right to change details of design, materials and finish. © 2004 Genlyte Thomas Group LLC (Lightolier Division) • D0504



Page 2 of 2

Electrical (continued from page 1)

- Automatic, battery protecting low voltage disconnect (LVD)
- Advanced battery diagnostics and management system
- Temperature compensated battery charger
- 24 hour recharge time
- High frequency, very low ripple current charger
- Input and output disconnect switch
- Battery disconnect switch

System Input/Output Ratings

Maintenance free, sealed lead calcium battery has an estimated service life of 10 years, and an operating temperature range of 65°F (19°C) to 85°F (30°C).

14.0 kVA Single Phase UPS System

Options

- 0 = None
- 1 = PC Format Diagnostics Software
- 4 = Remote Display + "5"
- 5 = Additional RS-232

SYSTEM RATING	INPUT VOLTAGE	INPUT AMPS ¹	AVAILABLE OUTPUT VOLTAGES/ MAX. LOAD AMPS ²		OCB POLE SPACES AVAILABLE		
			120 V	208 V	240 V	277 V	
14,000 VA	277	63.2	116.5	_	_	50.5	12
	208/240	80.8/70.0	116.5	67.3	58.3	—	12

NOTES:

Continuous Duty
 Total Load Not to Exceed System Rating

Warranty


Standard Warranty

Lightolier will provide parts and on-site labor for the first 90 days following shipment of product, and parts only for an additional 270 days.

Extended Warranty

(Available with purchase of Factory Start-Up Service) Lightolier will provide parts and on-site labor for the first 12 months following start-up of the product, and parts only for an additional 12 months.

System One-Line Diagram

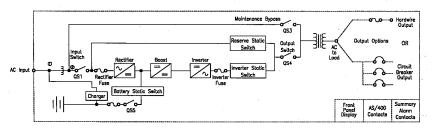

Computer Interface Pin Configuration (AS/400™)

Pin	Description	Function
8	Normal	System Functioning Normally
6	Load On Reserve	Double Conversion Inverter Not Operating
9	Power Failure	Load Supplied by Battery
7	End of Discharge Period	I Unit Will Soon Stop Operating
5	Common	Common Connection to Above 4 Signals





Job Information

Type:

 Lightolier
 a Genlyte Thomas Company
 www.lightolier.com

 631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710
 We reserve the right to change details of design, materials and finish.

 © 2004 Genlyte Thomas Group LLC (Lightolier Division) • D0504

LIGHTOLIER.